



UniMAP

**Optimal Location and Sizing of Distributed Generation
Using Particle Swarm Optimization with Mutation
Strategy**

by

**Wong Lye Yee
(0930910368)**

A thesis submitted
In fulfillment of the requirements for the degree of
Master of Science (Electrical Systems Engineering)

**School of Electrical Systems Engineering
UNIVERSITI MALAYSIA PERLIS**

2011

ACKNOWLEDGEMENT

This thesis would not have been possible done without the guidance and the help of several individuals, either directly or indirectly in the preparation and completion of this study. First and foremost, I would like to express my deepest appreciation and thanks to my supervisor, Mdm. Siti Rafidah binti Abdul Rahim and my co-supervisor, Mr. Mohd Herwan bin Sulaiman for their professional guidance and valuable advice in helping me to complete this project. This thesis too, would not have been possible without their continual support and encouragement. I also thank the staffs of School of Electrical System Engineering and Centre of Graduate Studies who provide me their professional knowledge. I would like to thank my parents and my brothers for their concern, encouragement, which is a motivation for me in completing this project. Last but not least, I would like to express my gratitude to my fellow friends who gave me warmest help, support, valuable advices and morale support throughout this project.

TABLE OF CONTENTS

	Page
THESIS DECLARATION	ii
ACKNOWLEDGEMENT	iii
TABLE OF CONTENTS	iv
LIST OF TABLES	viii
LIST OF FIGURES	x
LIST OF ABBREVIATIONS	xv
ABSTRAK	xvi
ABSTRACT	xvii
CHAPTER 1: INTRODUCTION	
1.1 Project Overview	1
1.2 Motivation	2
1.3 Problem statement	5
1.4 Scope	6
1.5 Objectives	7
1.6 Project Expectation	7
1.7 Report Organization	8
CHAPTER 2: LITERATURE REVIEW	
2.1 Introduction	10

2.2	Present Power Production	11
2.3	Distributed Generation	13
2.4	Distributed Generation Integration Using Analytical Methods	17
2.5	Distributed Generation Integration Using Metaheuristic Methods	20
2.5.1	Genetic Algorithm	21
2.5.2	Particle Swarm Optimization	22
2.5.3	Ant Colony Optimization	24
2.5.4	Other Metaheuristic Techniques	25
2.6	Summary	27
CHAPTER 3: RESEARCH METHODOLOGY		
3.1	Introduction	28
3.2	Research Design	29
3.3	Total Power Loss Calculation	32
3.3.1	Solving Power Flow Equation Using Newton-Raphson Technique	32
3.3.2	Power Loss Calculation	34
3.4	Metaheuristic Method	35
3.4.1	Concepts of Basic Particle Swarm Optimization	36
3.4.2	Genetic Algorithm	42
3.5	Distributed Generation Allocation Using PSO with Mutation Strategy	43
3.5.1	Algorithm of the PSO with Mutation Strategy	44
3.6	Summary	51

CHAPTER 4: RESULTS AND DISCUSSIONS

4.1	Introduction	52
4.2	Simulations Overview	52
4.3	Test Systems	53
4.3.1	24-Bus Distribution System	54
4.3.2	33-Bus Distribution System	54
4.3.3	69-Bus Distribution System	55
4.4	Parameters Setting	56
4.5	Case Scenarios	57
4.5.1	DG Unit Model Base	57
4.5.2	Case Scenarios for Test System	57
4.6	Simulation 1: 24-bus Distribution System	58
4.6.1	24-bus Distribution System with Case 0	58
4.6.2	24-bus Distribution System with Case 1	59
4.6.3	24-bus Distribution System with Case 2	60
4.6.4	24-bus Distribution System with Case 3	66
4.6.5	Discussions	72
4.7	Simulation 2: 33-bus Distribution System	72
4.7.1	33-bus Distribution System with Case 0	73
4.7.2	33-bus Distribution System with Case 1	73
4.7.3	33-bus Distribution System with Case 2	74
4.7.4	33-bus Distribution System with Case 3	81
4.7.5	Discussions	88
4.8	Simulation 3: 69-bus Distribution System	88
4.8.1	69-bus Distribution System with Case 0	89

4.8.2	69-bus Distribution System with Case 1	89
4.8.3	69-bus Distribution System with Case 2	90
4.8.4	69-bus Distribution System with Case 3	97
4.8.5	Discussions	103
4.9	Summary	104
CHAPTER 5: CONCLUSION		
5.1	Summary	105
5.2	Contribution	106
5.3	Future Work	107
REFERENCES		109
APPENDIX A: Worldwide Total Electricity Consumption from Year 2000 to Year 2008.		115
APPENDIX B: Distributed Generation (DG) Technologies and Characteristics.		116
APPENDIX C: System Data of 24-bus Distribution System		117
APPENDIX D: System Data of 33-bus Distribution System		119
APPENDIX E: System Data of 69-bus Distribution System		121
APPENDIX F: Simulation Results of 24-bus Distribution System		125
APPENDIX G: Simulation Results of 33-bus Distribution System		133
APPENDIX H: Simulation Results of 69-bus Distribution System		141
APPENDIX I: List of Publications		155

LIST OF TABLES

No.		Page
2.1	Worldwide installed capacity (GW) by 1 January 2000.	11
2.2	Distributed generation technologies and characteristics.	14
2.3	Worldwide electricity distribution losses (Billion Kilowatthours).	15
2.4	Distributed generation allocation methods using analytical methods.	18
2.5	Distributed generation allocation methods using metaheuristic methods.	20
3.1	The input data files for bus data and line data of the test system.	47
4.1	Parameters setting for PSO-MS method.	57
4.2	Simulation results of case 0 for PQ bus and PV bus using PSO-MS method.	59
4.3	Simulation results for case 2 using PSO-MS method for 20 simulations.	61
4.4	Simulation results for case 1 and case 2 using PSO-MS method.	61
4.5	Simulation results for three different methods for case 2.	63
4.6	Simulation results for case 3 using PSO-MS method for 20 simulations.	67
4.7	Simulation results for case 1 and case 3 using PSO-MS method.	67
4.8	Simulation results for three different methods for case 3.	69
4.9	Simulation results of case 0 for PQ bus and PV bus using PSO-MS method.	73
4.10	Simulation results for case 2 using PSO-MS method for 20 simulations.	76
4.11	Simulation results for case 1 and case 2 using PSO-MS method.	76
4.12	Simulation results for three different methods for case 2.	78

4.13	Simulation results for case 3 using PSO-MS method for 20 simulations.	83
4.14	Simulation results for case 1 and case 3 using PSO-MS method.	83
4.15	Simulation results for three different methods for case 3.	85
4.16	Simulation results of case 0 for PQ bus and PV bus using PSO-MS method.	89
4.17	Simulation results for case 2 using PSO-MS method for 20 simulations.	92
4.18	Simulation results for case 1 and case 2 using PSO-MS method.	92
4.19	Simulation results for three different methods for case 2.	94
4.20	Simulation results for case 3 using PSO-MS method for 20 simulations.	99
4.21	Simulation results for case 1 and case 3 using PSO-MS method.	99
4.22	Simulation results for three different methods for case 3.	101

© This item is protected by original copyright

LIST OF FIGURES

No.		Page
1.1	World marketed energy consumption from year 1980 till year 2030.	3
2.1	A typical electric power system.	10
2.2	World marketed energy consumption from year 1990 to 2035.	12
2.3	Worldwide distributed generation market growth.	13
2.4	Conventional power supply system vs. distributed generation.	16
3.1	A general flow chart of this research work using PSO-MS method.	29
3.2	A detailed flow chart of the entire project.	31
3.3	A schematic diagram of the PSO concept.	37
3.4	Interaction between particles to share the <i>g_{best}</i> information.	38
3.5	Concept of modification of a searching point by PSO.	39
3.6	The velocity and position update of particle <i>i</i> during two repeated iterations, <i>k+1</i> and <i>k+2</i> .	40
3.7	The variables of the DG allocation using PSO-MS method.	45
3.8	A flow chart of the PSO-MS algorithm.	46
3.9	Initialization of PSO parameters before the algorithm starts.	48
3.10	The detail explanation of PSO algorithm for one single loop.	49
3.11	A single loop process for the mutation algorithm.	50
4.1	A single-line diagram of 24-bus distribution system.	54
4.2	A single-line diagram of 33-bus distribution system.	55
4.3	A single-line diagram of 69-bus distribution system.	56

4.4	Voltage profile of 24-bus distribution system for case 1.	59
4.5	Graph of fitness function, H vs. number of iterations of 24-bus distribution system using PSO-MS method for case 2.	60
4.6	Graph of total real power loss (P_{loss}) for case 1 and case 2 using PSO-MS method.	62
4.7	Voltage profile deviation for case 1 and case 2 using PSO-MS method.	63
4.8	Graph of total real power loss (P_{loss}) reduction of 24-bus distribution system for case 2 using PSO-MS, PSO and GA method.	64
4.9	Simulation time of 24-bus distribution system for case 2 using PSO-MS, PSO and GA method.	65
4.10	Comparison of voltage profile of 24-bus distribution system using PSO-MS, PSO and GA methods for case 2.	65
4.11	Graph of fitness function, H vs. number of iterations of 24-bus distribution system using PSO-MS method for case 3.	66
4.12	Graph of total real power loss (P_{loss}) for case 1 and case 3 using PSO-MS method.	68
4.13	Voltage profile deviation for case 1 and case 3 using PSO-MS method.	69
4.14	Graph of total real power loss (P_{loss}) reduction of 24-bus distribution system for case 3 using PSO-MS, PSO and GA method.	70
4.15	Simulation time of 24-bus distribution system for case 3 using PSO-MS, PSO and GA method.	71
4.16	Comparison of voltage profile of 24-bus distribution system using PSO-MS, PSO and GA methods for case 3.	71

4.17	Voltage profile of 33-bus distribution system for case 1.	74
4.18	Graph of fitness function, H vs. number of iterations of 33-bus distribution system using PSO-MS method for case 2.	75
4.19	Graph of total real power loss (P_{loss}) for case 1 and case 2 using PSO-MS method.	77
4.20	Voltage profile deviation for case 1 and case 2 using PSO-MS method.	78
4.21	Graph of total real power loss (P_{loss}) reduction of 33-bus distribution system for case 2 using PSO-MS, PSO and GA method.	79
4.22	Simulation time of 33-bus distribution system for case 2 using PSO-MS, PSO and GA method.	80
4.23	Comparison of voltage profile of 33-bus distribution system using PSO-MS, PSO and GA methods for case 2.	81
4.24	Graph of fitness function, H vs. number of iterations of 33-bus distribution system using PSO-MS method for case 3.	82
4.25	Graph of total power loss (P_{loss}) for case 1 and case 3 using PSO-MS method.	84
4.26	Voltage profile deviation for case 1 and case 3 using PSO-MS method.	85
4.27	Graph of total real power loss (P_{loss}) reduction of 33-bus distribution system for case 3 using PSO-MS, PSO and GA method.	86
4.28	Simulation time of 33-bus distribution system for case 3 using PSO-MS, PSO and GA method.	87
4.29	Comparison of voltage profile of 33-bus distribution system using PSO-MS, PSO and GA methods for case 3.	87

4.30	Voltage profile of 69-bus distribution system for case 1.	90
4.31	Graph of fitness function, H vs. number of iterations of 69-bus distribution system using PSO-MS method for case 2.	91
4.32	Graph of total real power loss (P_{loss}) for case 1 and case 2 using PSO-MS method.	93
4.33	Voltage profile deviation for case 1 and case 2 using PSO-MS method.	94
4.34	Graph of total real power loss (P_{loss}) reduction of 69-bus distribution system for case 2 using PSO-MS, PSO and GA method.	95
4.35	Simulation time of 69-bus distribution system for case 2 using PSO-MS, PSO and GA method.	96
4.36	Comparison of voltage profile of 69-bus distribution system using PSO-MS, PSO and GA methods for case 2.	97
4.37	Graph of fitness function, H vs. number of iterations of 69-bus distribution system using PSO-MS method for case 3.	98
4.38	Graph of total real power loss (P_{loss}) for case 1 and case 3 using PSO-MS method.	100
4.39	Voltage profile deviation for case 1 and case 3 using PSO-MS method.	100
4.40	Graph of total real power loss (P_{loss}) reduction of 69-bus distribution system for case 3 using PSO-MS, PSO and GA method.	102
4.41	Simulation time of 69-bus distribution system for case 3 using PSO-MS, PSO and GA method.	102
4.42	Comparison of voltage profile of 69-bus distribution system using PSO-MS, PSO and GA methods for case 3.	103

LIST OF ABBREVIATIONS

DG	Distributed generation
LP	Linear Programming
TS	Tabu Search
PSO	Particle Swarm Optimization
CO ₂	Carbon dioxide
TNB	Tenaga Nasional Berhad
GA	Genetic Algorithm
ACO	Ant Colony Optimization
PSO-MS	Particle Swarm Optimization with mutation strategy
EP	Evolutionary Programming
ABC	Artificial Bee Colony

Lokasi dan Pensaizan Optimum Penjanaan Teragih Menggunakan Pengoptimuman Kerumunan Zarah Dengan Strategi Mutasi

ABSTRAK

Krisis tenaga yang berlaku pada masa sekarang telah membawa kepada peningkatan permintaan tenaga yang mesra alam sekitar dan berkecekapan tinggi. Antara semua penyelesaian, penjanaan teragih (DG) merupakan salah satu penyelesaian yang mampu menyelesaikan masalah ini. Kesan DG terhadap sistem teragih adalah penting di mana ia boleh digunakan untuk meningkatkan keboleharapan dan kecekapan sistem seperti meningkatkan profil voltan, mengurangkan kehilangan kuasa dan sebagainya. Lokasi dan saiz optimum DG adalah amat penting supaya boleh mendapatkan output maksimum daripada peruntukan DG. Ramai penyelidik mendapati bahawa cara penyelesaian menggunakan kaedah 'metaheuristic' menghasilkan keputusan yang lebih baik berbanding dengan kaedah analisis konvensional. Dalam tesis ini, Pengoptimuman Kerumunan Zarah (PSO) bergabung dengan strategi mutasi (PSO-MS) telah dicadangkan dalam menyelesaikan masalah peruntukan DG dengan tujuan mengurangkan kehilangan kuasa sebenar dan meningkatkan profil voltan sistem. Ini adalah untuk mengelakkan penakungan populasi zarah-zarah yang sentiasa berlaku di algoritma PSO. Satu set eksperimen komprehensif telah dijalankan untuk menyahihkan pelaksanaan kaedah yang dicadangkan di mana mereka boleh dikategorikan kepada sistem kecil (24-bas sistem teragih), sistem sederhana (33-bas sistem teragih) dan system besar (69-bas sistem teragih) untuk keadaan 1 DG dan 2 DG. Keputusan simulasi bagi kaedah PSO-MS dibandingkan dengan PSO dan Algoritma Genetik (GA) supaya dapat mengesahkan pelaksanaan kaedah yang dicadangkan. Keputusan-keputusan menunjukkan PSO-MS telah berjaya memperoleh lokasi dan saiz optimum DG. Untuk kajian perbandingan dengan PSO dan GA, kaedah PSO-MS juga menghasilkan satu keputusan yang lebih baik daripada kedua-dua kaedah dari segi kehilangan kuasa sebenar, profil voltan dan masa simulasi.

Optimal Location and Sizing of Distributed Generation Using Particle Swarm Optimization with Mutation Strategy

ABSTRACT

The current energy crisis has led to the increasing demand of environmental-friendly and high efficient energy. On top of all the solutions, distributed generation (DG) is one of the solutions that is capable to overcome this problem. The impact of DG towards the distribution system is significant where it can be used to improve the system reliability and efficiency such as improving the voltage profile, reducing the total power losses, etc. The optimal location and size of DG is very important in order to obtain the maximum output from the DG allocation. Many researchers found out that solutions using metaheuristic methods yield a better result compared to the conventional analytical method. In this thesis, the Particle Swarm Optimization (PSO) combined with the mutation strategy (PSO-MS) method is proposed in solving the DG allocation problem with the purpose of minimizing the total real power loss and improving the voltage profile of the system. This is to prevent the stagnancy of the particles' population that usually happens in PSO algorithm. A set of comprehensive simulations have been carried out to validate the performance of the proposed method where they are categorized into small system (24-bus distribution system), medium system (33-bus distribution system), and large system (69-bus distribution system) for single DG and 2 DGs installation. The simulation results of the PSO-MS method are then compared with PSO and Genetic Algorithm (GA) method in order to validate the performance of the proposed method. From the results, it is shown that the proposed method has successfully obtained the optimal DG location and size. As for the comparative study with PSO and GA, the PSO-MS method also yields a better performance in terms of total real power loss, voltage profile and simulation time.

CHAPTER 1

INTRODUCTION

1.1 Project Overview

Traditionally in the electric power industry, the main source of energy is powered by the large operating utilities such as hydro power plants, thermal power plants and nuclear power plants. However, this industry is facing some challenges nowadays due to the increasing in various types of demands such as high efficiency, more reliable and clean energy, as well as low energy costs. Therefore, introducing distributed generation (DG) to the distribution system is one of the solutions to solve these problems. Distributed Power Coalition of America, DPCA (Rújula, A. A. B., Amada, J. M. & Bernal-Agustín) defines DG as any small scale power generation technology that provides electric power at a site closer to customers than central station generation. According to them, a DG can be connected directly to the load customer or to a utility's transmission or distribution system.

The optimal number, location and size of the DG to be installed in the distribution system are crucial in solving the DG allocation problem. Placing the DG at wrong location or unsuitable size may deteriorate the efficiency and reliability of the distribution system, where it may increase the power loss, reduces the voltage profile hence bring negative impact to the distribution system. Therefore, finding the optimal location and size of DG is very important to obtain the maximum output from the DG

allocation. A lot of conventional analytical methods such as loss sensitivity method, Linear Programming (LP) and Lagrangian approach have been applied to solve the DG allocation problem. However, these methods are very time-consuming and low reliability, especially deal with complex power problems. With the advancement of computation technologies, many researchers have turned their attention to metaheuristic approach.

Metaheuristic method is a computational intelligent method that solves the optimization problems iteratively. It explores and exploits the search space effectively and efficiently in finding an optimal solution. Metaheuristic methods include local search-based methods such as Tabu Search (TS) (Nara, K., Hayashi, Y., Ikeda, K. et al., 2001) and population-based methods such as Particle Swarm Optimization (PSO) (AlHajri, M. F., AlRashidi, M. R., & El-Hawary, M. E., 2007), Ant Colony Optimization (ACO) (Falaghi, H., & Haghifam, M.-R., 2007) and others.

In this project, PSO is combined with mutation strategy to improve the performance of existing PSO method in determining the DG optimal location and size while reducing the total real power loss and improving voltage profile of the system. Mutation strategy is implemented to prevent the PSO particles to be trapped in the local minima, which cause the stagnancy of the population, hence yield a better result in solving the DG allocation problem.

1.2 Motivation

Nowadays, the world electric power industry is facing a tough challenge due to several factors and the energy shortage crisis is one of the major problems that need to be solved. The world energy consumption has been increased drastically since the year

1980, as shown in Figure 1.1. In a survey conducted by the U.S Department of Energy, it is predicted that the energy consumption will reach 722 quadrillion BTU by the year 2030. Detailed information on worldwide total electricity consumption can be referred to Appendix A.

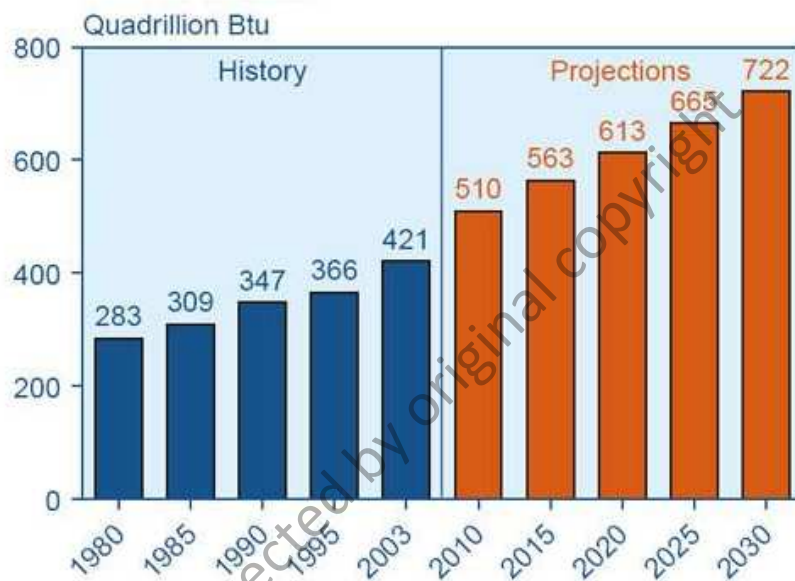


Figure 1.1: World marketed energy consumption from year 1980 till year 2030.

(Source: U.S. Department of Energy)

Although a few new technologies have been developed in order to manage the increasing demands, the rate at which the power is generated might be different with the demand growth rate. Nuclear power plant is one of the solutions that applied by some country to solve the energy shortage problem since it can generate electricity with low fuel cost and less pollutions. However, strict protocols and safety regulations need to be taken into account when dealing with this power plant. The incident of Tsunami and earthquake in Japan at March 2011 that caused the explosions and leaks of radioactive gas at Fukushima Daiichi Nuclear Power Station had brought fresh debate over the nuclear power plants expansion. Some countries even put the brakes on in planning the

nuclear power plant. Switzerland has canceled the plans of building new nuclear power plants and upgrades the older one until complete safety review has been done, while Germany government has decided to shut down all the nuclear power plants by the year 2022.

The rising awareness of public towards the green and clean energy has become one of the demands that need to be fulfilled by the local electrical company. According to the 2011 Edition of Global Energy Statistical Yearbook by Enerdata on June 2011, the carbon dioxide (CO_2) emissions to the earth atmosphere are close to 6%, which is at the highest level currently.

Another challenge that the world is facing today is the shortage of the natural resources which are used as the power source such as coal, oil, gas and others. This has led to the increasing price of these resources, and simultaneously affecting the electrical company. In Malaysia, the local electrical company, Tenaga Nasional Berhad (TNB) has experienced a net loss of RM 440.2 million in their third quarter report of year 2011 owing to the increasing price of coal and gas.

Due to the various difficulties and drawbacks of the current electric power industry, the energy trend is now shifting to more reliable and smaller generators. DG is introduced for its advantages for instance small in size and can be associated with different technologies in generating energy, whether is renewable type or non-renewable type, thus reducing the negative impact to the environment, users and electrical company. In industry, DG often used as back-up power source, especially in resilience, emergency services, hospitals, air-ports and others. Because of its multiple positive impacts to the distribution system, DG is widely used in dealing with distribution system problems. More information regarding the benefits of DG can be referred to (U. S. Department of Energy, 2005). Some of the benefits of DG can be

summed up as follows (U. S. Department of Energy, 2005) (Aghaebrahimi, M. R., & Amiri, M., 2009):

- i. The transmission and distribution costs and losses can be reduced because DG units are located near the customers.
- ii. It is easier to find site for small DG installation.
- iii. DG units can act as back-up power source during electricity shortage.
- iv. DG units can reduce the land-use effect due to the small size of DG.
- v. DG units can increase the power efficiency and reliability of the electric system.

1.3 Problem Statement

DG is an emerging approach that is well known in electric power system recently. The installation of DG in the distribution system has brought lots of advantages to the electric power industry such as green and clean energy or higher voltage stability and reliability. The current electric industry may face some challenges with the absence of DG in the distribution system. Long and costly transmission lines are needed to transfer the power from the large power plants which are situated far away from the users. Furthermore, there are lacks of land used and natural minerals for the construction of these large operating utilities.

Conventionally, analytical approaches such as loss sensitivity factor, Lagrangian methods and others are applied to the distribution system in solving the DG allocation problem. However, these methods are difficult to implement with the low reliability and efficiency. The simulation of the algorithms takes a very long time due to the

complexity of the system. In addition, different test systems with different complexity and constraints will affect the simulation time of the algorithm. Therefore, metaheuristic method such as Genetic Algorithm (GA), Particle Swarm Optimization (PSO), Ant Colony Optimization (ACO) and others are then proposed in solving the DG allocation problem. In general PSO, the particles may converge too fast during the searching process, which cause the stagnancy of the population. Therefore, the general PSO is modified by implementing the mutation strategy of the GA in order to overcome the shortage of the general PSO.

Different distribution system may need different number of DG to be installed in the distribution system. Therefore, the number of DG to be installed in the distribution system should be considered in the DG allocation problem in order to obtain the maximum output from the DG installation.

1.4 Scope

In this research, DG is introduced into the distribution system with the purpose of reducing the total real power loss and increasing the voltage profile of the system. The real power loss and voltage are two main factors in DG allocation problem. With the reduction in total real power loss and improvement in voltage profile, the customers will experience better voltage stability and reliability. However, this can only be achieved with the DG located at the optimal location and size. Therefore, the optimal location and size of the DG have to be determined in order to obtain the maximum benefit from the DG. In this project, a metaheuristic method which is PSO with mutation strategy (PSO-MS) is proposed in dealing with the DG allocation problem. The PSO-MS approach improves the basic PSO by combining the mutation strategy to

overcome the shortcoming of the basic PSO, which is the stagnancy of the particles' population.

1.5 Objectives

The main objective of this research work is to develop a modified particle swarm optimization method in determining the optimal location and size of DG to be installed in the distribution system. These objectives can be summarized as follow:

- i. To develop Particle Swarm Optimization (PSO) with mutation strategy algorithm in determining the optimal location and size of DG to be installed in distribution system, while minimizing the total real power loss and improving the voltage profile of the system.
- ii. To investigate the effects of numbers of DG installed towards the total real power loss and voltage profile in the distribution system.
- iii. To evaluate the performance of the proposed method in different case scenarios and compare the results of PSO-MS algorithm with PSO and GA method.

1.6 Project Expectation

The main goal of this project is to determine the optimal DG location and size in the distribution system using PSO-MS method. In spite of obtaining the optimal location and size of DG, the proposed method is expected to reduce the total real power loss and increase the voltage profile of the system. The proposed approach is tested on

three different test systems, which are 24-bus, 33-bus and 69-bus distribution system. Furthermore, the PSO-MS technique is then compared with the PSO and GA in order to validate the performance of the proposed method. The PSO-MS algorithm is expected to yield better result than PSO and GA in terms of total real power loss and voltage profile of the system, as well as the simulation time of the algorithms.

1.7 Report Organization

The report begins with an overall introduction of the project which includes a brief explanation on the DG, followed by its contribution towards the distribution system. In addition, the expected output of the proposed metaheuristic method is also discussed.

Chapter 2 presents the literature review of previous research done and methodology used in solving the DG allocation problem. This chapter begins with the background information of DG, including its technologies, applications and impacts towards the distribution system. A detailed review on both analytical and metaheuristic methods used in the DG allocation problem is presented.

The methodology used in solving the DG allocation problem is explained in Chapter 3. It starts with the total power loss calculation, where Newton-Raphson load flow method was used. A full description including the theory and mathematical formulation of the proposed metaheuristic method which is PSO-MS and its algorithm is clearly presented in the following section. Some assumptions that made are also highlighted in this chapter.

Chapter 4 presents the results and discussions of the proposed method. PSO-MS approach is tested on three different test systems under three different case scenarios in

order to evaluate its robustness. A brief introduction of the test systems used are also presented in this chapter.

Chapter 5, which is the last chapter, ends with an overall summary and conclusion which include the future works of the project.

© This item is protected by original copyright